

Riverbank Acoustical Laboratories (RAL)<sup>TM</sup> / An Alion Science Technical Center  
 Laboratory Measurement of Airborne Sound Transmission Loss  
 of Building Partitions ASTM E 90-04/NVLAP 08/P06

TEST NUMBER: TL07-391 TEST DATE: DECEMBER 21, 2007

CLIENT: Quiet Solution, LLC  
 DESIGNATION: QR 527 3 5/8" double 24 steel 24 oc R-13 QR 527 QS 350

DIMENSIONS: 168" wide x 108" high x 9.5" thick  
 AREA: 126.0 ft<sup>2</sup>  
 WEIGHT: 835.75 lbs AREA WEIGHT: 6.63 lbs/ft<sup>2</sup>  
 SPECIMEN DETAILS:

SOURCE ROOM: Room 2 Volume = 6297.6 ft<sup>3</sup> Area = 2066.2 ft<sup>2</sup>  
 RECEIVE ROOM: Room 1 Volume = 6254.5 ft<sup>3</sup> Area = 2042 ft<sup>2</sup>  
 FILE NAME: TL07\_391\_071221\_A.doc

FREQ. (Hz)	T.L. (dB)	UNC. (dB) 95%CL	DEF. (dB) <CONT	FREQ. (Hz)	T.L. (dB)	UNC. (dB) 95%CL	DEF. (dB) <CONT
100	<b>34</b>	0.82		800	<b>69</b>	0.16	
125	<b>42</b>	0.64	7	1k	<b>70</b>	0.11	
160	<b>45</b>	0.61	7	1.25k	<b>72</b>	0.12	
200	<b>48</b>	0.53	7	1.6k	<b>73</b>	0.15	
250	<b>53</b>	0.43	5	2k	<b>73</b>	0.12	
315	<b>60</b>	0.40	1	2.5k	<b>76</b>	0.09	
400	<b>62</b>	0.32	2	3.15k	<b>80</b>	0.06	
500	<b>65</b>	0.21		4k	<b>79</b>	0.05	
630	<b>67</b>	0.16		5k	<b>81</b>	0.06	

**Sound Transmission Class (STC) = 65**

Total Deficiencies = 29

Extended Frequency Data


FREQ.	T.L.	UNC.	DEF.	FREQ.	T.L.	UNC.	DEF.
40	<b>19</b>	0.64		6.3k	<b>82</b>	0.04	
50	<b>21</b>	1.06		8k	<b>80</b>	0.10	
63	<b>25</b>	0.56		10k	<b>76</b>	0.12	
80	<b>33</b>	0.66					

R: 63  
 OITC: 48

Test Conducted by: Marc Sciaky

This single report page and accompanying graph contain the instantaneous raw data as provided to the client after testing of the specimen. This data, although accurate, is incomplete without the full specimen description, mounting details and signature pages. The full report referenced by the RAL test number above should be consulted for further information regarding these results.

SOUND TRANSMISSION REPORT  
RAL - TL07-391

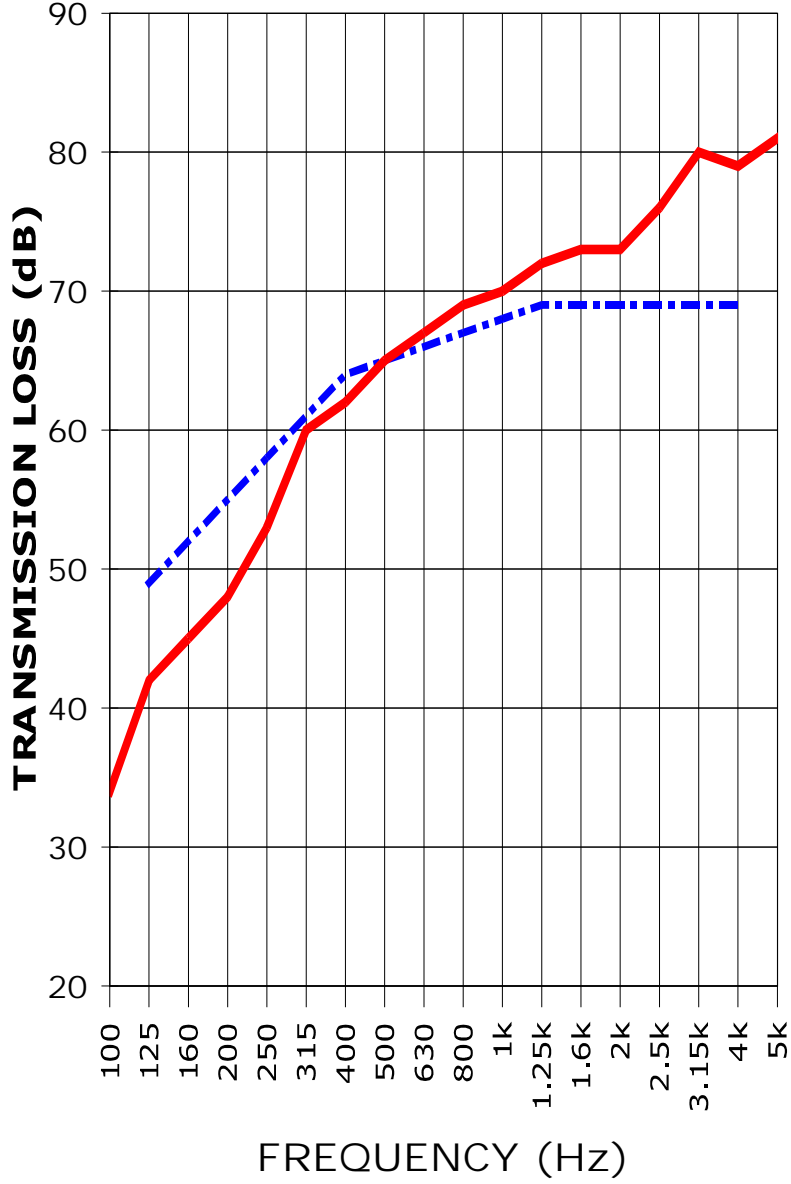

FREQUENCY (Hz)

STC = 65



TRANSMISSION LOSS  
SOUND TRANSMISSION LOSS CONTOUR

TEST NUMBER: TL07-391 TEST DATE: DECEMBER 21, 2007

ASTM E90 RAW DATA ANALYSIS TLALCS

FREQ	FILL	+	AMB	*	SOR	-REC	=NR	+10 Log (Sc/A)	TLc	TLs	Abs	Unc w/95 % C.L.
40	NA		28.0		96.5	77.9	18.6	0.5	19.2	<b>19.0</b>	111.3	0.64
50			30.5		98.9	79.8	19.1	1.5	20.6	<b>21.0</b>	88.6	1.06
63			33.5		103.1	78.8	24.3	1.1	25.4	<b>25.0</b>	97.3	0.56
80			35.5		101.3	70.9	30.3	2.2	32.6	<b>33.0</b>	75.7	0.66
100			26.4		103.1	70.2	32.9	1.1	34.0	<b>34.0</b>	98.9	0.82
125			33.9		101.1	61.5	39.6	2.4	42.0	<b>42.0</b>	72.5	0.64
160			26.2		105.0	62.8	42.2	2.4	44.6	<b>45.0</b>	72.6	0.61
200			24.8		102.0	57.1	44.9	3.4	48.2	<b>48.0</b>	57.7	0.53
250			21.0		97.4	47.6	49.8	3.4	53.2	<b>53.0</b>	57.8	0.43
315			17.5		101.3	44.7	56.6	3.3	59.9	<b>60.0</b>	59.4	0.40
400			14.9		101.6	42.7	58.8	3.4	62.3	<b>62.0</b>	57.3	0.32
500			14.3		99.7	37.8	61.9	3.3	65.2	<b>65.0</b>	59.5	0.21
630			11.6		100.2	36.7	63.5	3.5	67.0	<b>67.0</b>	56.7	0.16
800			14.6		97.9	32.5	65.4	3.5	68.9	<b>69.0</b>	56.9	0.16
1k			13.5		99.6	32.7	66.9	3.1	70.0	<b>70.0</b>	61.3	0.11
1.25k			9.9		103.7	34.5	69.2	2.6	71.8	<b>72.0</b>	69.5	0.12
1.6k			8.5		103.8	33.1	70.7	2.3	73.0	<b>73.0</b>	73.4	0.15
2k			7.5		102.0	31.0	71.0	1.9	72.9	<b>73.0</b>	80.9	0.12
2.5k			7.2		102.8	28.0	74.8	1.4	76.2	<b>76.0</b>	90.5	0.09
3.15k			7.7		102.1	23.2	78.9	1.0	79.9	<b>80.0</b>	100.7	0.06
4k			8.0		100.4	21.7	78.7	0.2	78.9	<b>79.0</b>	119.4	0.05
5k			9.1	*	98.5	16.8	81.7	-0.6	81.0	<b>81.0</b>	145.8	0.06
6.3k			9.8	***	95.8	12.0	83.8	-1.7	82.2	<b>82.0</b>	184.6	0.04
8k			10.2	***	94.3	11.5	82.8	-2.9	79.9	<b>80.0</b>	245.3	0.10
10k			10.5	***	92.1	11.8	80.3	-4.2	76.1	<b>76.0</b>	331.0	0.12

STC = 65 Def = 29

INPUTS:

PULSE PROGRAM TEMPLATE: TL_Sor2_Rec1_Pre-c.plt		AVERAGING TIME:	32 sec
FREQUENCY RANGE: 40 Hz to 10000 Hz		NUM OF MEASUREMENTS:	5
Environmental Conditions			
Source Room Start:	70°F 53 % RH	Receive Room Start:	69°F 51 % RH
Source Room Comp:	70°F 50 % RH	Receive Room Comp:	69° F 51 % RH
Source RUN Key:	TL07_391_S2_071221_A	Receive RUN Key:	TL07_391_R1_071221_A
		Ambient RUN KEY:	AMB1_071221_A
		<b>SPECIMEN AREA:</b>	<b>126.0 ft<sup>2</sup></b>
<b>FILE NAME:</b>	<b>TL07_391_071221_A.doc</b>	FILLER WALL:	NA

'\*' or '\*\*\*' on right of AMB see Receive raw data

Test Conducted by: Marc Sciaky