

Riverbank Acoustical Laboratories (RAL)TM / An Alion Science Technical Center
 Laboratory Measurement of Airborne Sound Transmission Loss
 of Building Partitions ASTM E 90-04/NVLAP 08/P06

TEST NUMBER: TL07-019 TEST DATE: JANUARY 23, 2007

CLIENT: Quiet Solution, LLC
 DESIGNATION: ID 05: QuietRock 525 24"oc WS wall w/ R-13 fiberglass and 5/8 Type X

DIMENSIONS: 97" wide x 108" high x 4.875" thick
 AREA: 72.5 ft² (Filler: 53.5 ft² Comp: 126.0 ft²)
 WEIGHT: 451.75 lbs AREA WEIGHT: 6.21 lbs/ft²
 SPECIMEN DETAILS:

SOURCE ROOM: Room 2 Volume = 6297.6 ft³ Area = 2066.2 ft²
 RECEIVE ROOM: Room 1 Volume = 6254.5 ft³ Area = 2042 ft²
 FILE NAME: TL07_019_070123_A.doc

| FREQ. (Hz) | T.L. (dB) | UNC. (dB) 95%CL | DEF. (dB) <CONT | FREQ. (Hz) | T.L. (dB) | UNC. (dB) 95%CL | DEF. (dB) <CONT |
|---------------|--------------|-----------------------|-----------------------|---------------|--------------|-----------------------|-----------------------|
| 100 | 17 | 1.05 | | 800 | 53 | 0.17 | |
| 125 | 31 | 0.41 | 4 | 1k | 53 | 0.14 | 1 |
| 160 | 37 | 0.64 | 1 | 1.25k | 54 | 0.15 | 1 |
| 200 | 37 | 0.60 | 4 | 1.6k | 54 | 0.12 | 1 |
| 250 | 41 | 0.35 | 3 | 2k | 51 | 0.13 | 4 |
| 315 | 46 | 0.29 | 1 | 2.5k | 51 | 0.09 | 4 |
| 400 | 46 | 0.28 | 4 | 3.15k | 55 | 0.07 | |
| 500 | 50 | 0.25 | 1 | 4k | 54 | 0.05 | 1 |
| 630 | 51 | 0.26 | 1 | 5k | 55 | 0.07 | |

Sound Transmission Class (STC) = 51

Total Deficiencies = 31

Extended Frequency Data


| FREQ. | T.L. | UNC. | DEF. | FREQ. | T.L. | UNC. | DEF. |
|-------|-----------|------|------|-------|-----------|------|------|
| 40 | 26 | 0.69 | | 6.3k | 59 | 0.05 | |
| 50 | 17 | 0.88 | | 8k | 61 | 0.06 | |
| 63 | 18 | 0.81 | | 10k | 63 | 0.07 | |
| 80 | 18 | 0.67 | | | | | |

R: 50
 OITC: 32

Test Conducted by: Marc Sciaky

This single report page and accompanying graph contain the instantaneous raw data as provided to the client after testing of the specimen. This data, although accurate, is incomplete without the full specimen description, mounting details and signature pages. The full report referenced by the RAL test number above should be consulted for further information regarding these results.

SOUND TRANSMISSION REPORT
RAL - TL07-019

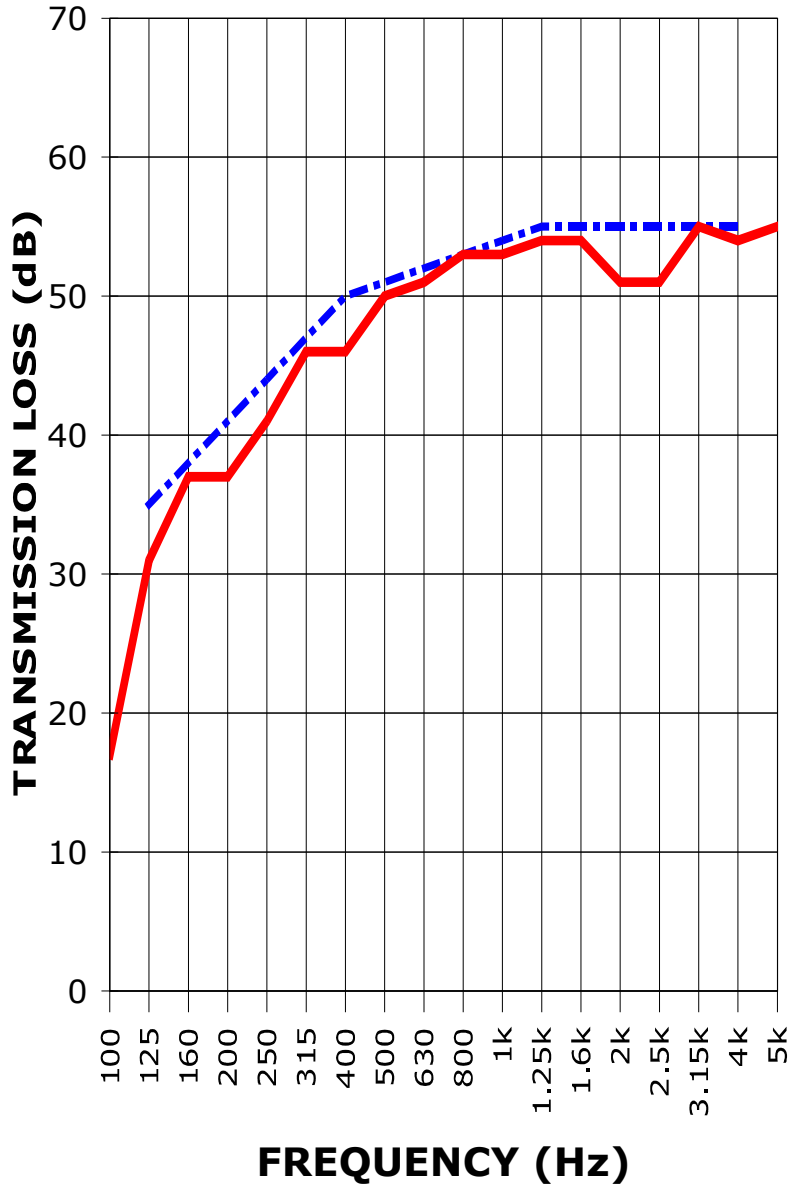

STC = 51



TRANSMISSION LOSS
SOUND TRANSMISSION LOSS CONTOUR